




Gate Burton

ENERGY PARK

Overhead lines are made up of three parts:

- **Conductor** – the cable used to transport electricity
- **Pylon** – the tower used to support the conductors
- **Insulator** – used to safely connect the conductors to the pylon

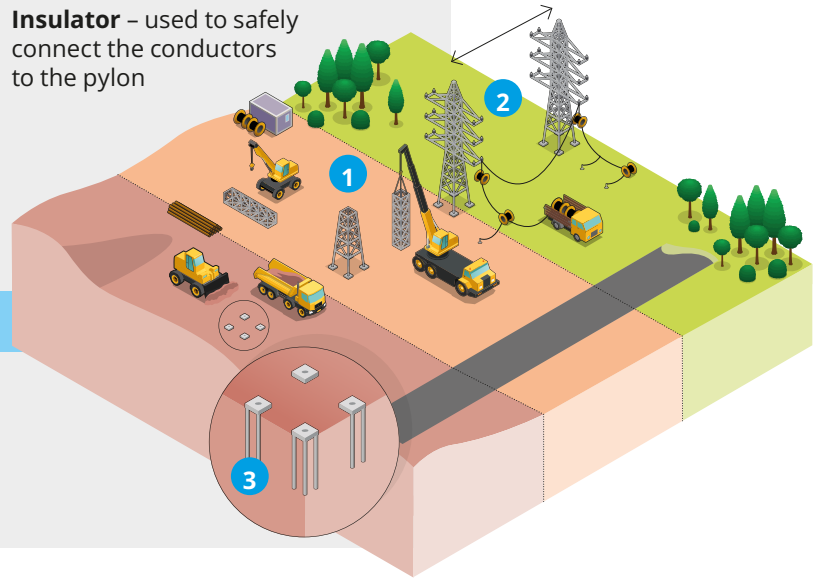

Overhead lines

1. Height of the pylons between 30m-50m*
2. Distance between pylons approx 360m*
3. Foundations approx 6m deep*